

Test Report

03.05.2019

Operator

CA Mätssystem AB
Björn Johansson
Sjöflygvägen 35

Stockholm, Täby 183 62
08-50 52 68 08

Test Site

CA Mätssystem AB
Björn Johansson
Sjöflygvägen 35


Täby, Stockholm 183 62
08-50 52 68 00

Modell: 6550, ID: 200545, Firmware: V3.1

Comments

Manteltest.dvb



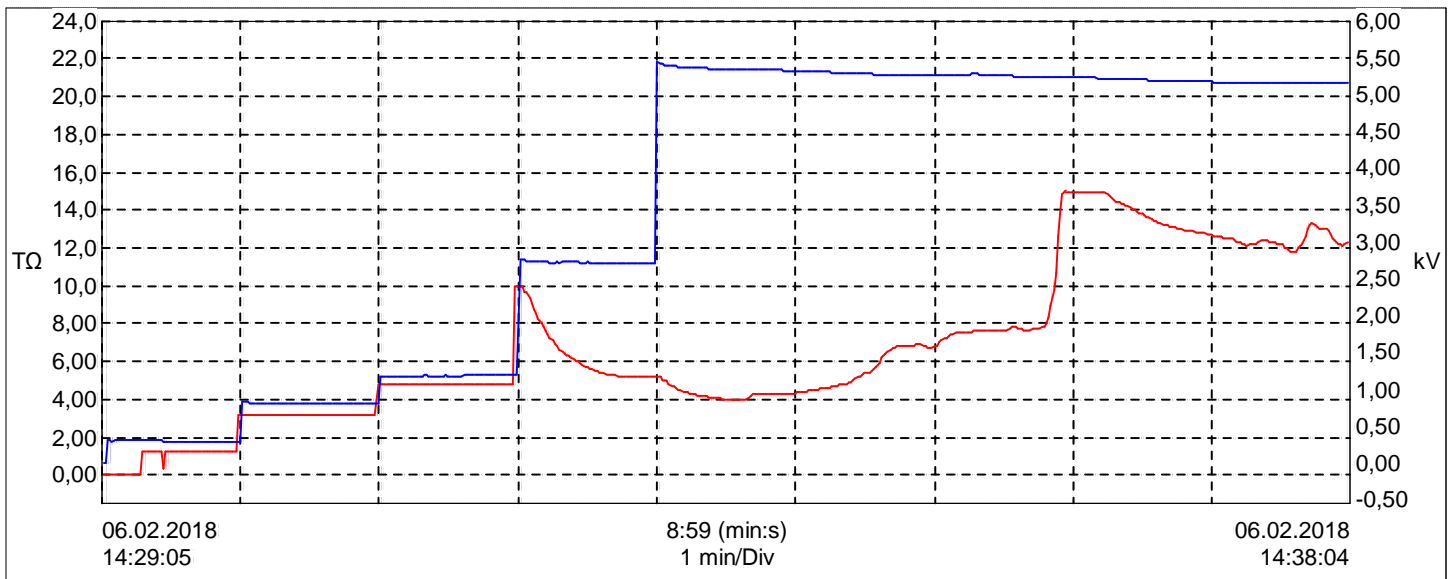

Test Name	Objekt 2, Test 1 (R)
Function	Steg V
Start Date	06.02.2018
Start Time	14:29:05
Run-time	8:59 (min:s)
Voltage	5,150kV
Resistance	12,34T Ohm

ΔR	----- Ω (Undefined)
ΔV	4,849k V
$\Delta R / (R * \Delta V)$	----- (Undefined)
Capacitance	0,000 F
Current	311,8p A

Index	Name
1	Objekt 2, Test 1 (R)

Objekt 2, Test 1 (R) (Ω)				
Index	Time	Val	Units	Samples
1	1,007 (s)	0,0	Ω	1
2	2,015 (s)	0,0	Ω	1
3	3,022 (s)	0,0	Ω	1
4	4,030 (s)	0,0	Ω	1
5	5,037 (s)	0,0	Ω	1
6	6,045 (s)	0,0	Ω	1
7	7,052 (s)	0,0	Ω	1
8	8,060 (s)	0,0	Ω	1